


Caution: Label all wires prior to disconnection when servicing controls. Wiring errors can cause improper and dangerous operation.



NOTE: Some units use a jumper in place of the thermodisk.

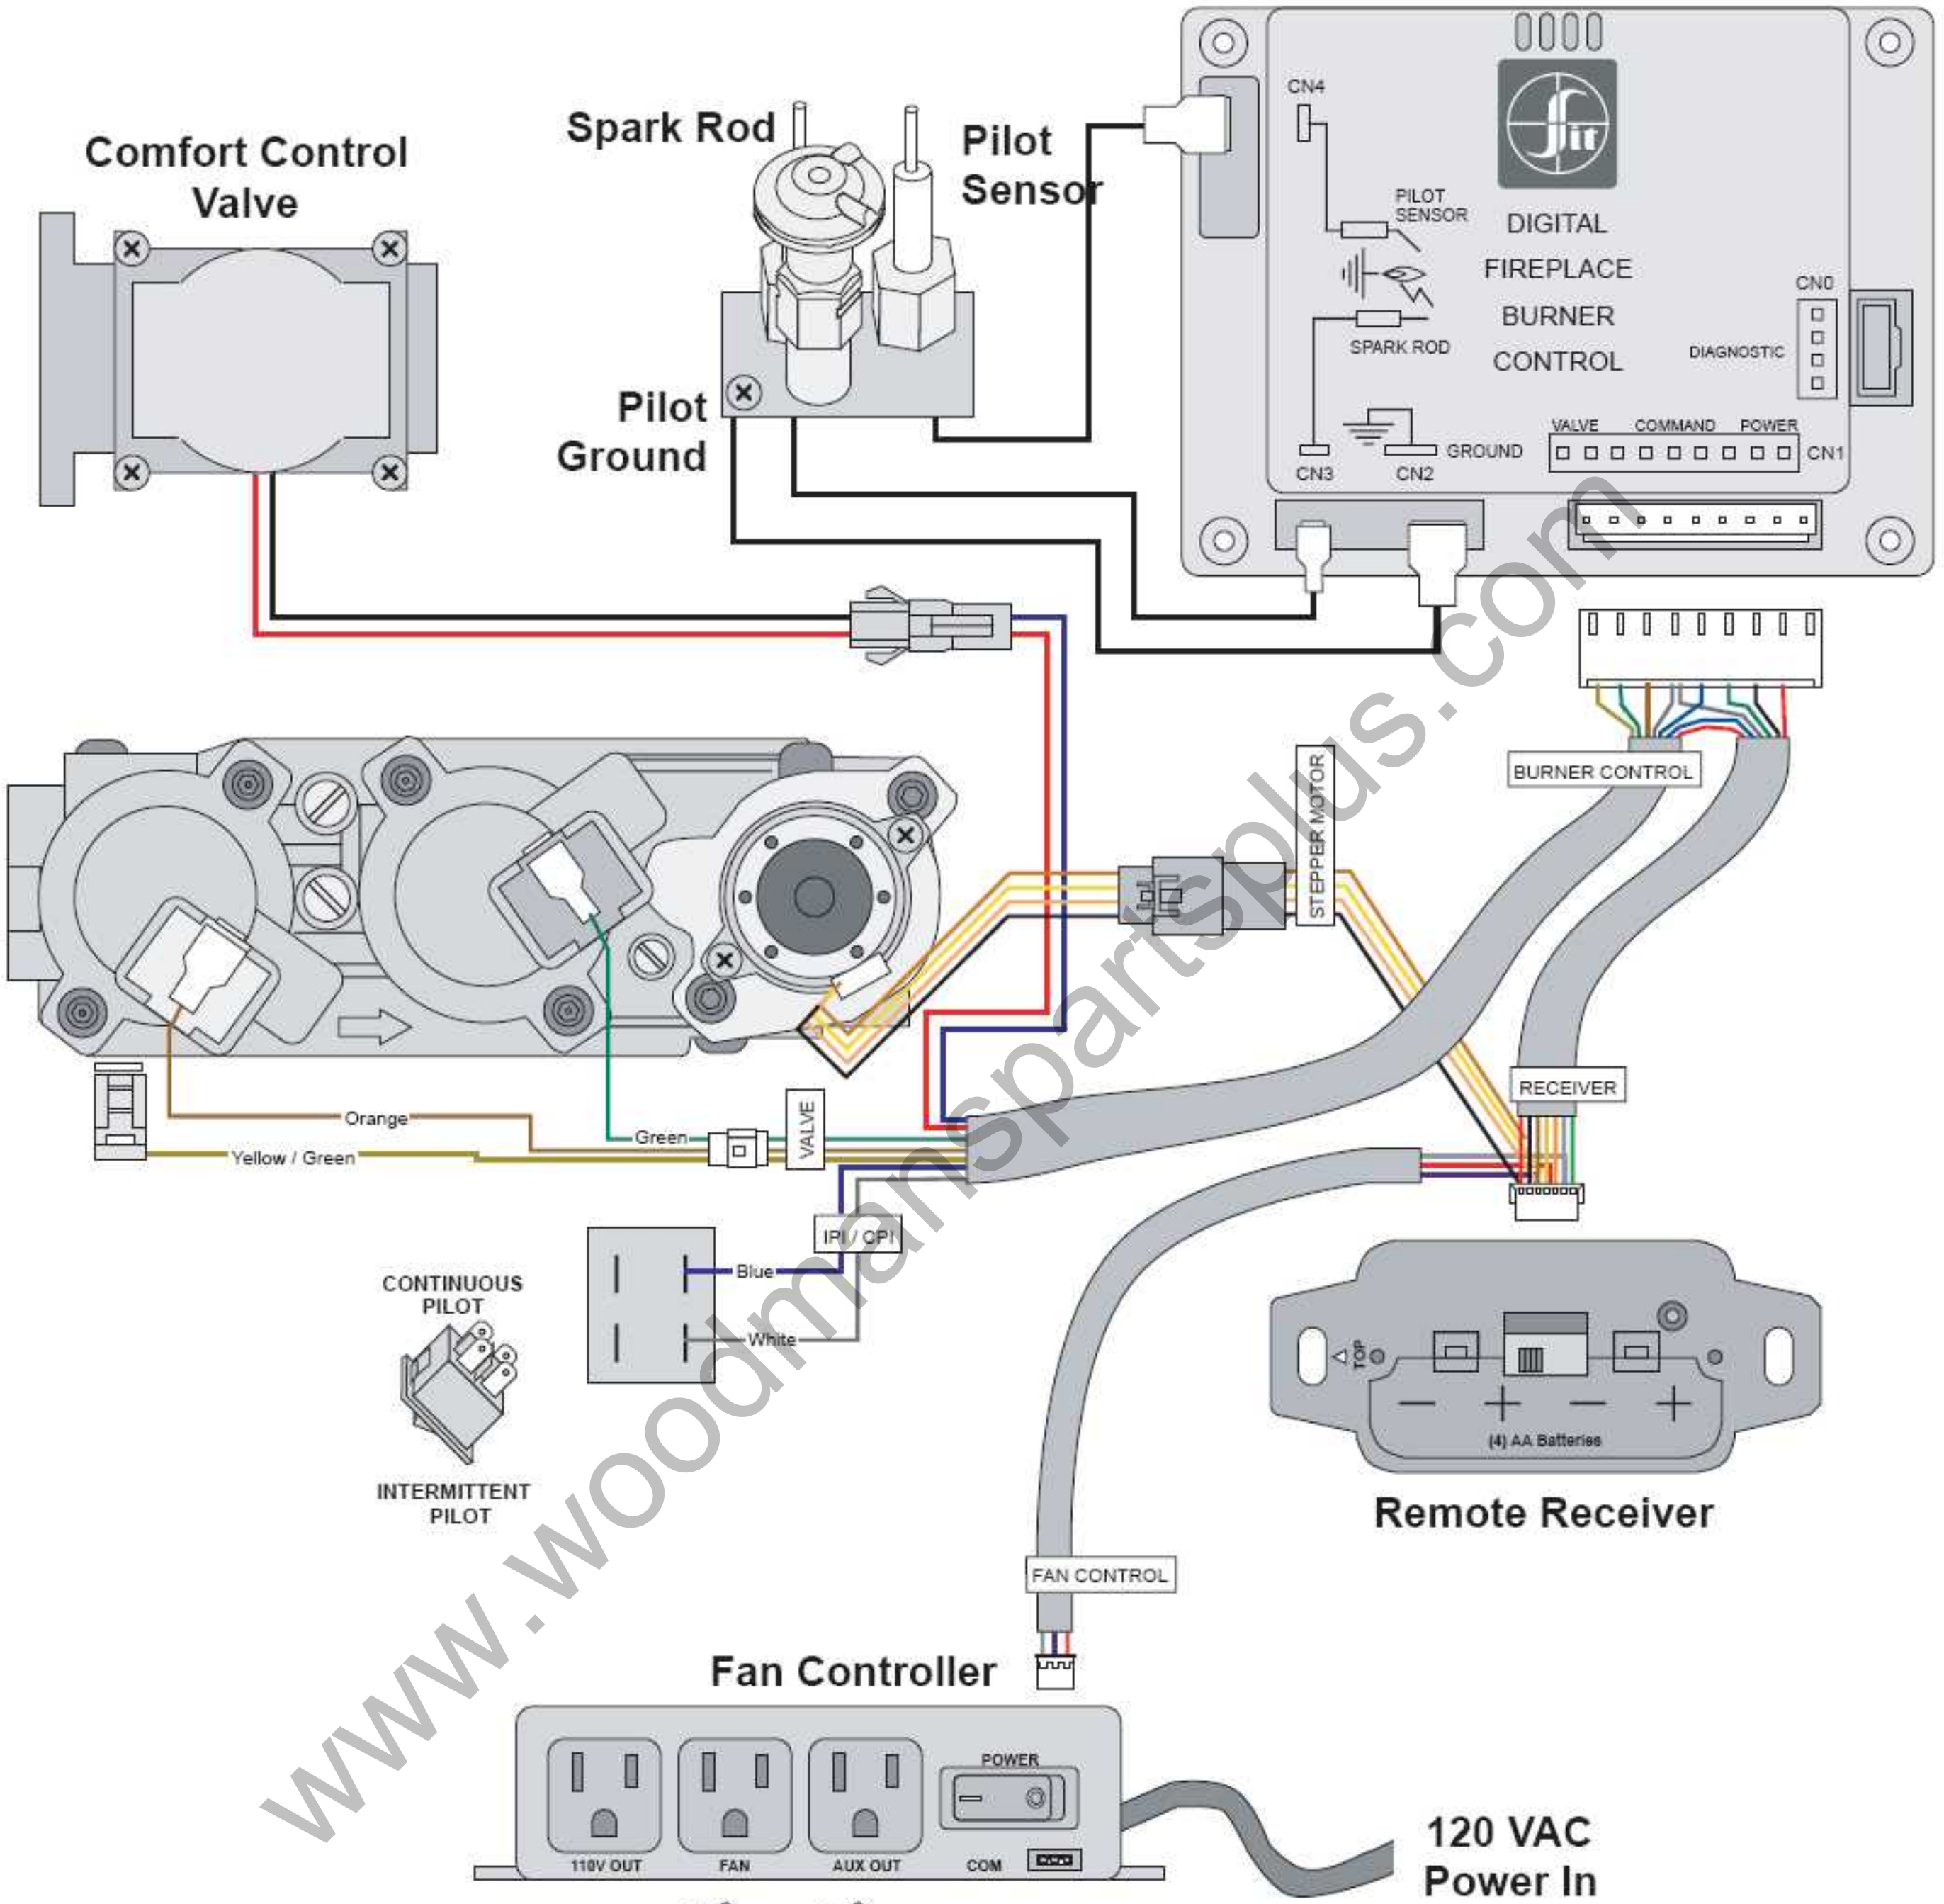